

# Bus power supply 640 mA

Product code: EK-AB1-TP



Datasheet STEKAB1TP\_EN

KNX device with function of power supply for a bus line. It has to be used in KNX installations for control of homes and buildings.



# Description

The ekinex® power supply EK-AB1-TP is a KNX device for rail mounting which produces and monitors the 30 Vdc voltage required to operate the bus system. The device has an integrated choke which provides the decoupling between the power supply and the information on the bus line. On a KNX bus line can be connected up to 64 KNX bus devices. The output is protected from overload and short circuit. The device can support short interruptions of the mains voltage (max 200 ms).

# **Functions**

- 30 Vdc SELV power supply for a KNX bus line with max 64 connected devices
- · Reset of the connected bus line with a dedicated pushbutton

# Main characteristics

- · Housing in plastic material
- Mounting on 35 mm rail (according to EN 60715)
- Protection degree IP20 (according to EN 60529)
- · Classification climatic 3K5 and mechanical 3M2 (according to EN 50491-2)
- Pollution degree 2 (according to IEC 60664-1)
- · Weight 150 g
- 4 modular units (1 unit = 18 mm)
- Dimensions 72 x 90 x 70 mm (WxHxD)

### **Environmental conditions**

• Operating temperature: - 5 ... + 45°C

- Storage temperature: 25 ... + 55°C
- Transport temperature: 25 ... + 70°C
- Relative humidity: 95% not condensing

#### **Technical data**

### Power supply


- Voltage 230 Vac, 50/60 Hz
- Input current 0,1 A
- Power consumption 22 W (power losses < 3 W)

#### Outputs

- Bus line voltage: 30 Vdc +1/-2 Vdc SELV
- Rated current: 640 mA
- Buffer time: 200 ms
- Bus line connection: KNX terminal block (black/red) included

# Switching, display and connection elements

The device is equipped with a reset pushbutton, 3 LEDs and terminal blocks for mains voltage 230 Vac and KNX bus line.

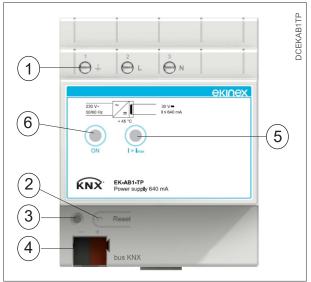

- 1) Terminal blocks for power supply 110-230 Vac 50/60 Hz
- 2) Reset pushbutton 3) Reset LED (red)
- 4) Terminal block for KNX bus line
- 5) Overload/short circuit LED (red) 6) Output voltage LED (green)

#### **Planning**

Planning a KNX bus installation, the use of a 640 mA power supply unit requires to take into account the following guidelines:

- the maximum number of bus devices connected is 64:
- the maximum length of a line segment is 350 m, measured along the line between the power supply and the furthest device bus:
- the maximum distance between two bus devices cannot exceed 700 m;
- the maximum length of a bus line is 1000 m, keeping into account all segments.


At the same bus line can be connected not more than two power supplies. A second power supply may be necessary when the installation in distribution boards requires a particular concentration of the bus devices (tipically more than 30 units installed within 10 m). In this case a power supply has to be installed near the group of devices. Between two power supplies installed on the same bus line a minimum distance of 200 m is required, measured along the line.

### Mounting

The device has degree of protection IP20, and is therefore suitable for use in dry interior rooms. The housing is made for rail mounting according to EN 60715 in boards or cabinets for electrical distribution. The installation is in horizontal position, the correct position is when the KNX bus terminal is located at the bottom and the terminals ( $\frac{1}{\pm}$ , L, N) for connecting the mains power supply 230 Vac are located at the top. For the installation of the device on the rail proceed as follows:

- with the aid of a tool bring the locking device in the fully lowered position (1);
- place the upper edge of the rear inner profile on the upper edge of the rail (2);
- rotate the device towards the rail (3);
- push the locking device upward until it stops (4).

Before removing the device, be sure the bus terminals have been extracted from their slots. Use a screwdriver to slide down the locking device and remove the device from the rail.

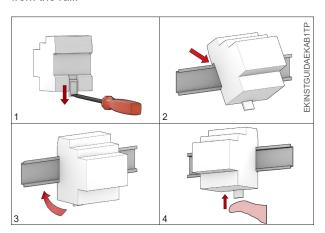



**Note.** When mounting the device in boards and cabinets it shall be provided the necessary ventilation so that the temperature can be kept within the operating range of the device.

### **Electrical connections**

### Main supply 230 Vac

The connection to the 230 main supply Vac is made with screw terminals ( $\frac{1}{2}$ , L, N) located on the upper front of the device. Characteristics of the terminal blocks:

- · screw clamping of conductors
- maximum cross section of conductor 2.5 mm²
- · recommended wire stripping approx. 6 mm
- · torque max 0.8 Nm

# KNX bus line


The connection to the KNX bus line is made with the terminal block (black/red) included in delivery and inserted into the slot located on the bottom part of the front. Characteristics of the KNX terminal block:

- · spring clamping of conductors
- · 4 seats for conductors for each polarity
- terminal suitable for KNX bus cable with single-wire conductors and diameter between 0.6 and 0.8 mm
- · recommended wire stripping approx. 5 mm
- color codification: red = + (positive) bus conductor, black = - (negative) bus conductor



Warning! In order to supply the KNX bus lines use only KNX bus power supplies (e.g. ekinex EK-AB1-TP or EK-AG1-TP). The use of other power supplies can compromise the communication and damage the devices connected to the bus.

DCEKAB1

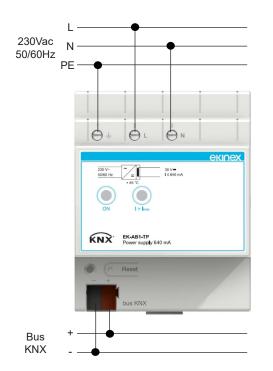



Warning! The electrical connection of the device can be carried out only by qualified personnel. The incorrect installation may result in electric shock or fire. Before making the electrical connections, make sure the power supply has been turned off.

## **Configuration and commissioning**

### Configuration

The device does not require any configuration with ETS® (Engineering Tool Software) tool. The application software APEKAB1TP##.knxprod (## = version) is available in order to add an EK-AB1-TP power supply to an ETS project.

# Commissioning

For the commissioning of the device turn on the mains power supply 230 Vac to which the device is connected. The green LED marked "ON" indicates the device operating.


#### Reset

The device has a reset pushbutton. After a reset, the bus line is not powered for 20 seconds and the bus devices connected are restored to their original condition. During this interval of time the reset LED (red) is turned permanently on.

# Failure

When the red LED, labeled "I> Imax", is turned on, this means that the KNX output is overloaded or short-circuited. The problem can be solved by removing the cause of the short circuit or by reducing the number of KNX devices connected to the line. After the removal of the problem only the green LED "ON" is turned on, at this time it is recommended to reset the line.

### **Dimensions [mm]**

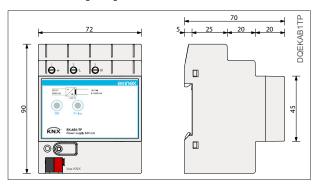

#### **Marks**

- KNX
- CE: the device complies with the Low Voltage Directive (2006/95/EC) and the Electromagnetic Compatibility Directive (2004/108/EC). Tests carried out according to EN 50491-2:2010, EN 50491-3:2009, EN 50491-4-1:2012, EN 50491-5-1:2010, EN 50491-5-2:2010, EN 50428:2005 + A1:2007 + A2:2009

#### **Maintenance**

The device is maintenance-free. To clean use a dry cloth. It must be avoided the use of solvents or other aggressive substances.

### Disposal



At the end of its useful life the product described in this datasheet is classified as waste from electronic equipment in accordance with the European Directive 2002/96/EC (RAEE), and cannot be disposed together with the municipal undifferentiated solid waste.



Warning! Incorrect disposal of this product may cause serious damage to the environment and human health. Please be informed about the correct disposal procedures for waste collecting and processing provided by local authorities.

#### **Documentation**

This datasheet refers to the release A1.0 of the ekinex® device EK-AB1-TP, and is available for download at www. ekinex.com as a PDF (Portable Data Format) file.

File name	Device release	Updating
STEKAB1TP_EN.pdf	A1.0	07 / 2014

# Warnings

- Installation, electrical connection, configuration and commissioning of the device can only be carried out by qualified personnel in compliance with the applicable technical standards and laws of the respective countries
- The power supply line to which the device is connected must be equipped with an easily accessible disconnecting device with minimum separation distance between contacts of 3 mm
- Opening the housing of the device causes the immediate end of the warranty period
- In case of tampering, the compliance with the essential requirements of the applicable directives, for which the device has been certified, is no longer guaranteed

 ekinex® KNX defective devices must be returned to the manufacturer at the following address: EKINEX S.p.A.
Via Novara 37, I-28010 Vaprio d'Agogna (NO) Italy

#### Other information

- This datasheet is aimed at installers, system integrators and planners
- For further information on the product, please contact the ekinex<sup>®</sup> technical support at the e-mail address: support@ekinex.com or visit the website www.ekinex. com
- Each ekinex<sup>®</sup> device has a unique serial number on the label. The serial number can be used by installers or system integrators for documentation purposes and has to be added in each communication addressed to the EKINEX technical support in case of malfunctioning of the device
- KNX® and ETS® are registered trademarks of KNX Association cvba, Brussels

@ EKINEX S.p.A. The company reserves the right to make changes to this documentation without notice.